


Detail: Pipe Bedding, Backfill and Asphalt Concrete Pavement Reinstatement

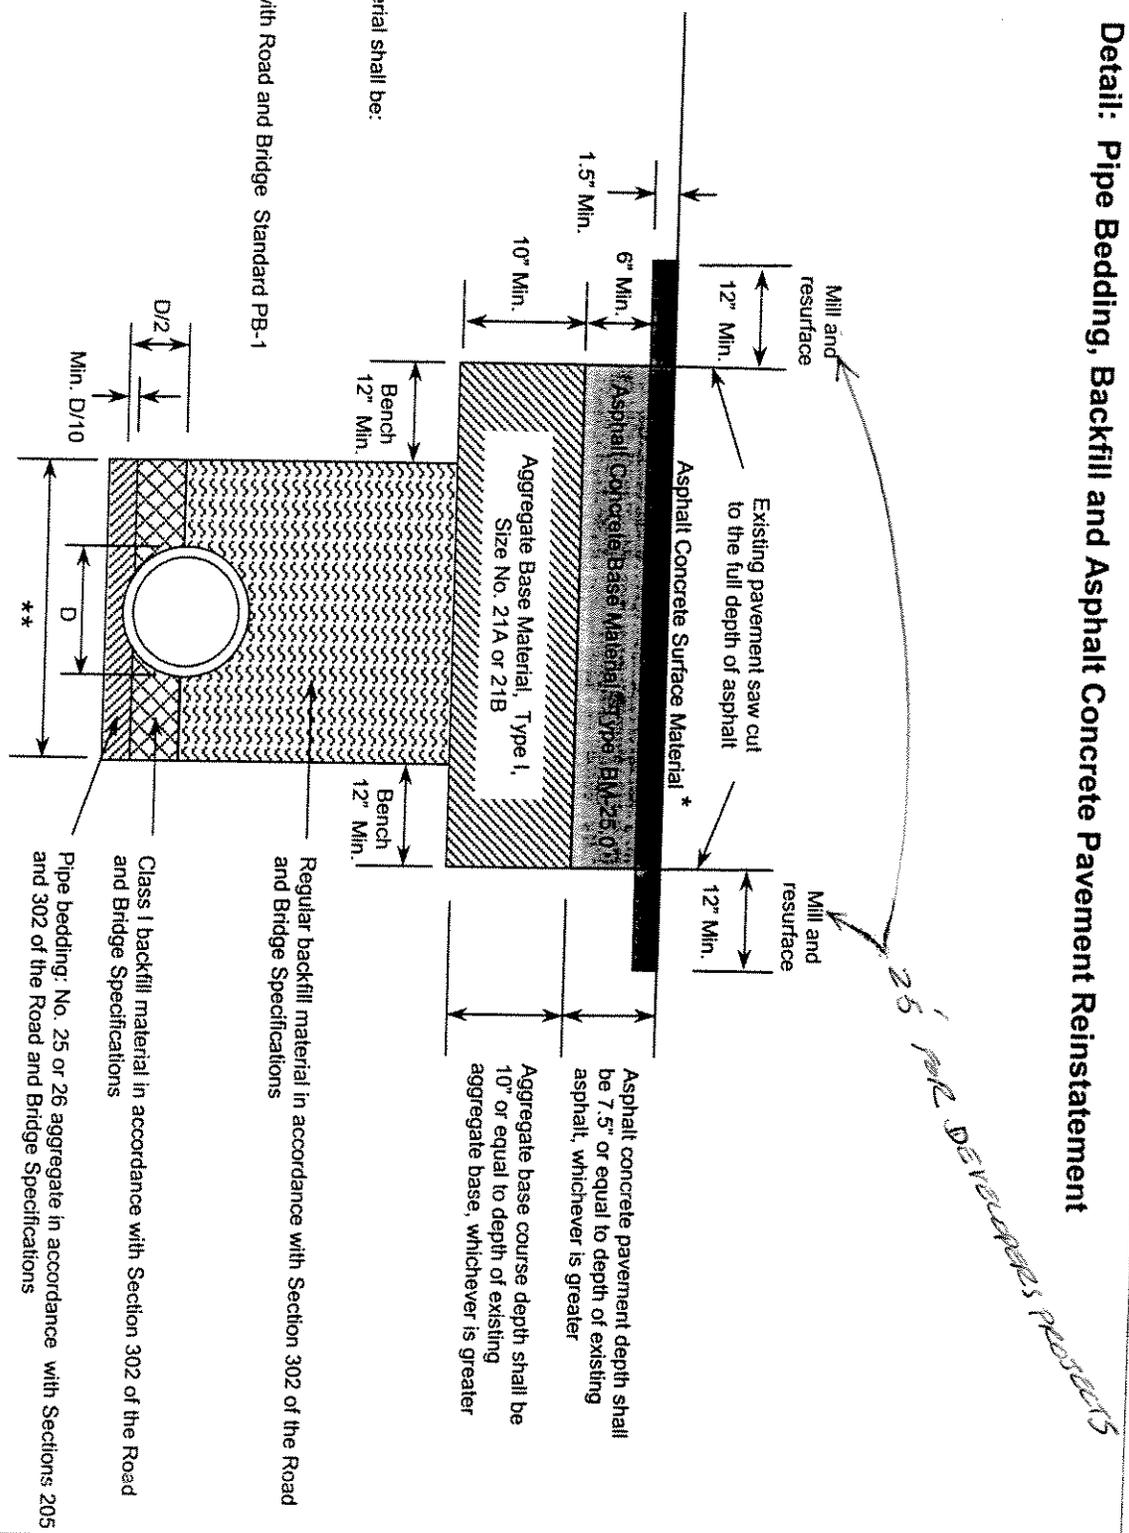


* Asphalt concrete surface material shall be:
SM-9.5A if ADT < 10,000
SM-9.5D if ADT > 10,000

** Trench width in accordance with Road and Bridge Standard PB-1

Not to Scale

Detail: Pipe Bedding, Backfill and Hydraulic Cement Concrete Pavement Reinstatement

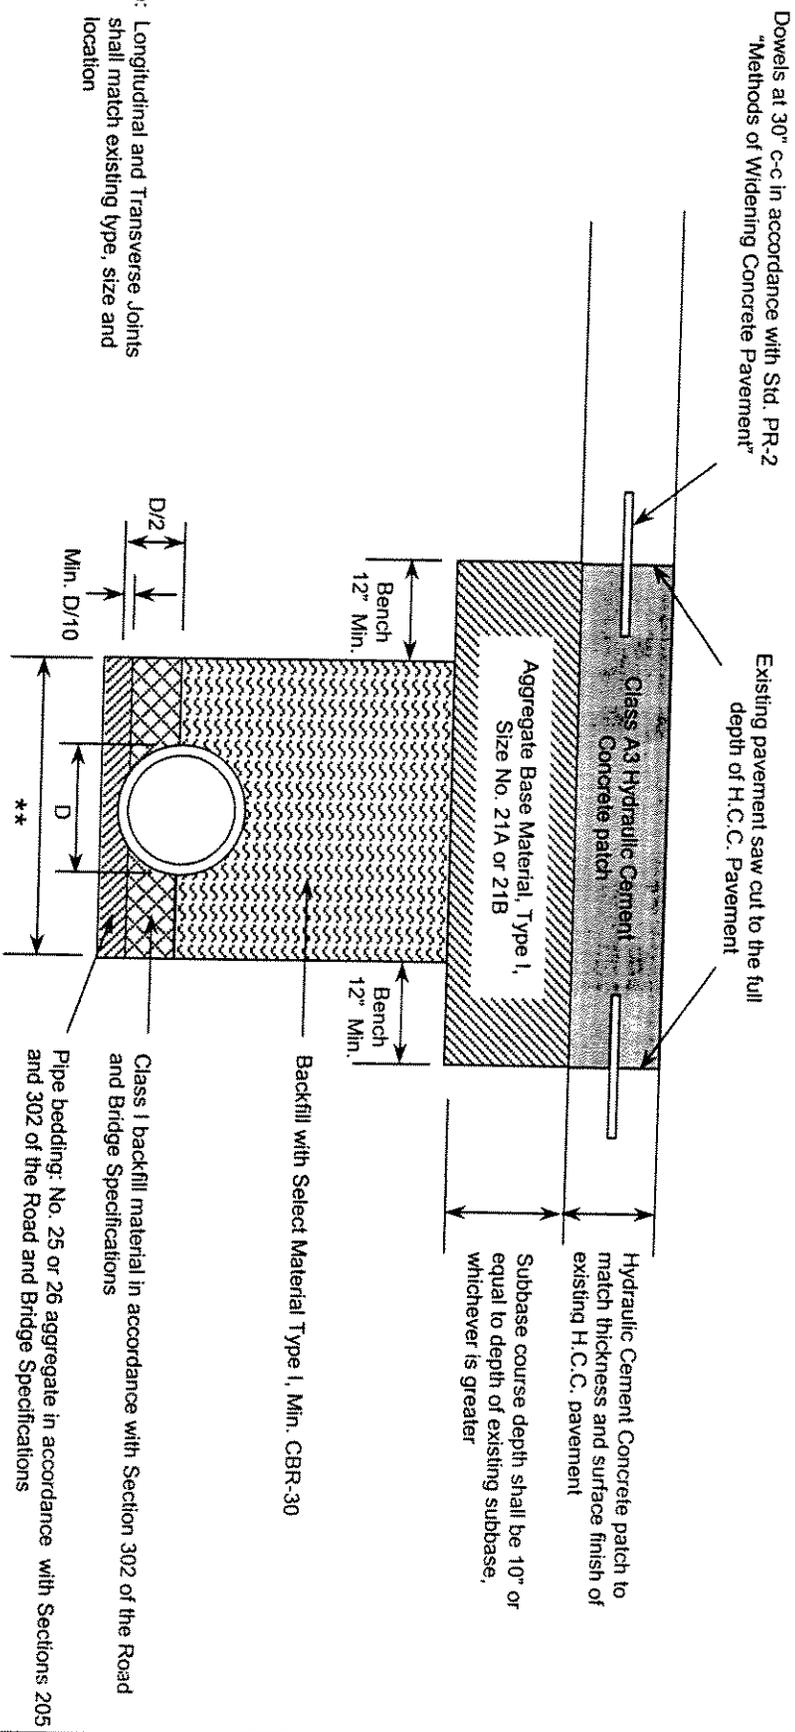

Note: Longitudinal and Transverse Joints shall match existing type, size and location

Not to Scale